






**MECHANICAL TEST REPORT TO AS/NZS4325.1:1995**  
**TriCab B10/H240 SHEAR BOLT LUG**

Test Number: ACC17007  
 Date: 21 June 2017  
 Standard: AS/NZS 4325.1-1995  
 Connector Type: Mechanical Shear Bolt Lug with conductive grease  
 Product Code: **B10-ABXX/XH240**  
 Conductor Type: Circular Flexible Class 5 Aluminium Conductor  
 Cable Type and Cross-sectional Area: **TriCab KL-PAXA/1C185BK**  
 Conductor Length: > 500 mm  
 Number of Sample Tested: 3  
 Tooling: Hex Socket and Wrench  
 Preparation of Connection: Insulation is stripped to the desired length. Conductor is inserted to the barrel of the lug. Bolts are tightened and sheared using the hex socket and manual wrench.  
 Machine and Data logger: Tensile Test machine model DK-50 with Smart test data logger to record the acceleration and load.  
 Load Application Rate: 500 N/s  
 Maximum Tensile Strength: 7.4 kN  
 Maintaining Time for the maximum tensile strength: **60 seconds without movement/slips between conductor and shear bolt**

RESULT: **PASS**

Tested by: *Greg Beziuk (TriCab Test Engineer)*   
*George Young (TriCab Test Engineer)*   
*Zoey Zao (TriCab Test Engineer)*   
*Andrew Ngo (TriCab Mechanical Engineer)*   
*Fernando Agustin (TriCab Technical Manager)* 

Witnessed by: *Adrian Brown (DNV•GL)*








This document has been digitally signed and will therefore not have handwritten signatures.


**MECHANICAL TEST REPORT TO AS/NZS4325.1:1995**  
**TriCab B10/H240 SHEAR BOLT LUG**

Test Number: ACC17008  
 Date: 21 June 2017  
 Standard: AS/NZS 4325.1-1995  
 Connector Type: Mechanical Shear Bolt Lug with conductive grease  
 Product Code: **B10-ABXX/XH240**  
 Conductor Type: Circular Flexible Class 5 Aluminium Conductor  
 Cable Type and Cross-sectional Area: **TriCab KL-PAXA/1C240BK**  
 Conductor Length: > 500 mm  
 Number of Sample Tested: 3  
 Tooling: Hex Socket and Wrench  
 Preparation of Connection: Insulation is stripped to the desired length. Conductor is inserted to the barrel of the lug. Bolts are tightened and sheared using the hex socket and manual wrench.  
 Machine and Data logger: Tensile Test machine model DK-50 with Smart test data logger to record the acceleration and load.  
 Load Application Rate: 500 N/s  
 Maximum Tensile Strength: 9.6 kN  
 Maintaining Time for the maximum tensile strength: **60 seconds without movement/slips between conductor and shear bolt**

RESULT: **PASS**

Tested by: *Greg Beziuk (TriCab Test Engineer)*   
*George Young (TriCab Test Engineer)*   
*Zoey Zao (TriCab Test Engineer)*   
*Andrew Ngo (TriCab Mechanical Engineer)*   
*Fernando Agustin (TriCab Technical Manager)* 

Witnessed by: *Adrian Brown (DNV•GL)*

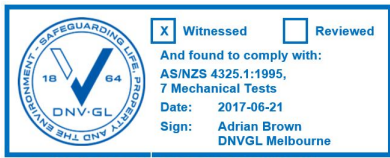

This document has been digitally signed and will therefore not have handwritten signatures.